


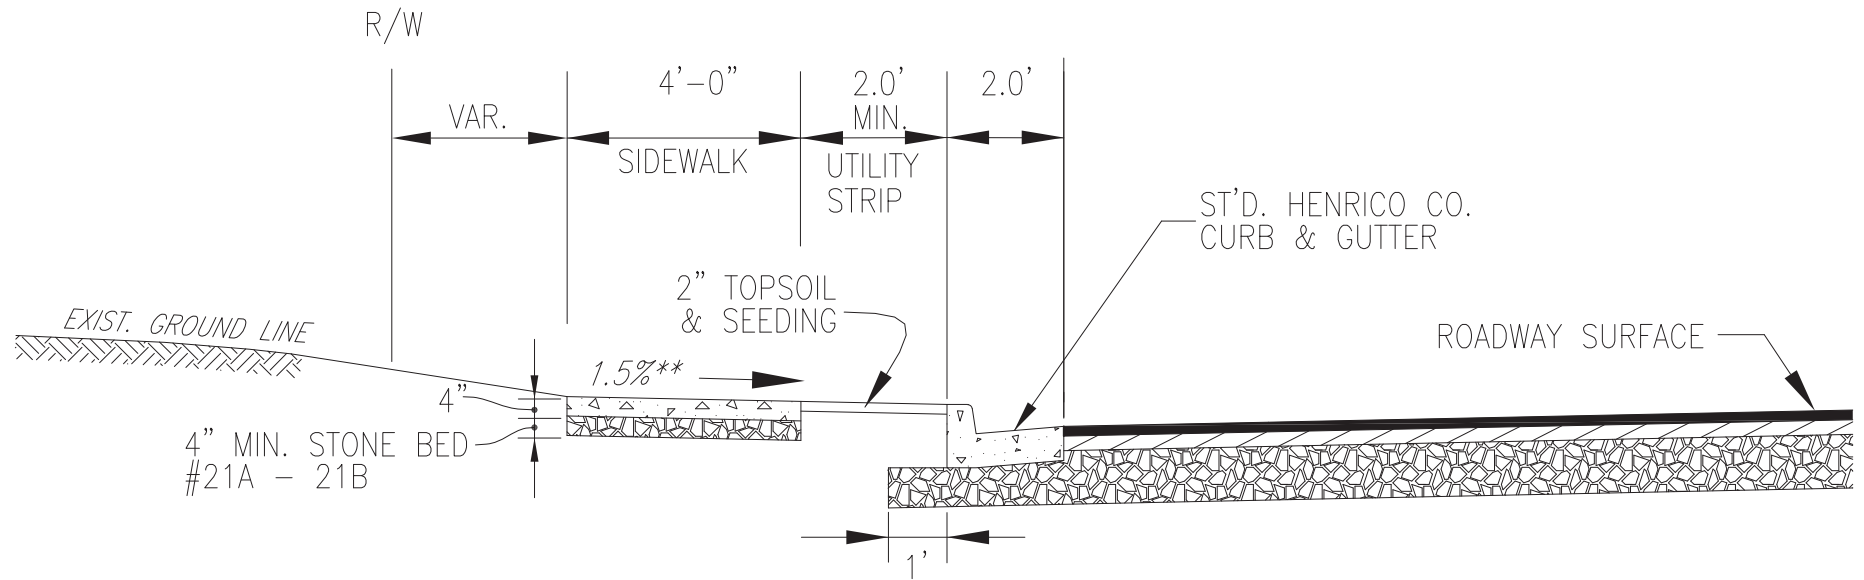

#### NOTES:


DEPTH OF SIDEWALK SHALL BE 7" AT ALL LOCATIONS SUSCEPTIBLE TO VEHICULAR TRAFFIC.

CONCRETE SHALL BE CLASS A-3.

SEE VDOT ST'D CG-12 FOR SIDEWALK TREATMENT ADJACENT TO COMMERCIAL ENTRANCES AND INTERSECTIONS.

A PEDESTRIAN PASSING AREA MUST BE PROVIDED AT 200' INTERVALS. ENTRANCES AND STREET INTERSECTIONS CAN BE UTILIZED AS PASSING AREAS.

\*\* 1.5% RECOMMENDED 2.0% MAX ALLOWED

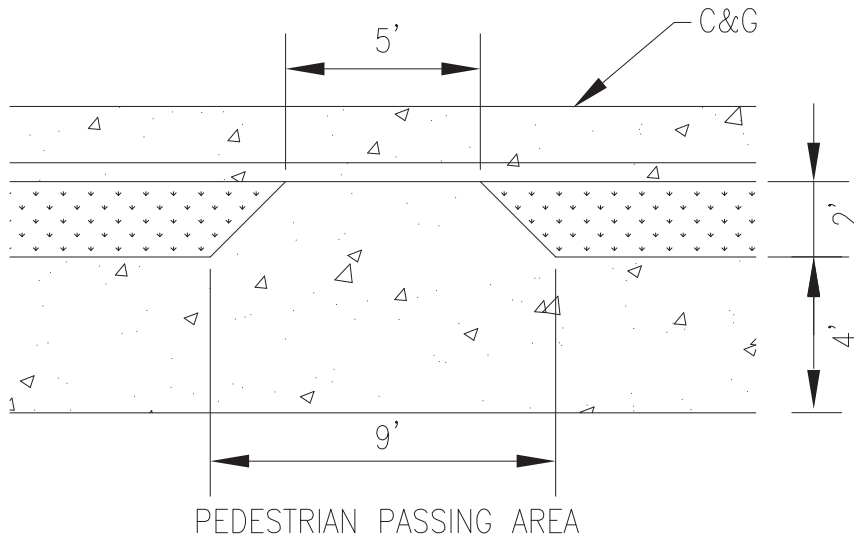

## SIDEWALK DETAIL

FOR RETROFIT APPLICATIONS ONLY

County of Henrico  
Department of Public Works

SEPTEMBER 1, 2021

C-12.DWG

